


PRESSURE TRANSMITTERS





Series 621 and 622

Explosion-proof

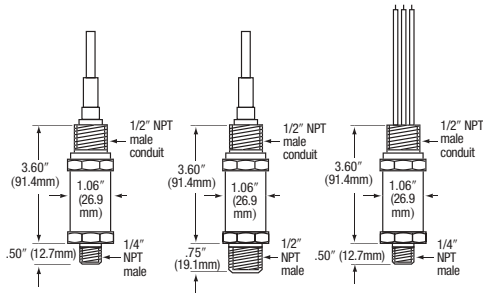

For ranges 0 psi to 30 psi and higher

For ranges less than 0 psi to 30 psi



For ranges 0 psi to 30 psi and higher

For ranges less than 0 psi to 30 psi

The
Instrumentation
Company

CORPORATE HEADQUARTERS
1010 West Bagley Road
Berea, Ohio 44017
440.243.0888
440.243.3472 Fax
E-mail: noshok@noshok.com
Web: www.noshok.com

NOSHOK
INCORPORATED

NUMEP 04

(Factory Mutual and Canadian
Standards Association Approved)



NOSHOK

General

NOSHOK series 621 and 622 pressure transmitters are approved for use in hazardous location applications as follows:

Explosion-proof for Class I, Division 1, Groups A, B, C and D; Dust Ignition-proof for Class II and III, Division 1, Groups E, F and G. FM standards according to FMRC 3600, 3615 and 3810

These transmitters must be installed and operated according to NEC and local codes. Improper installation or modifications to the electrical connection will void the hazardous approval rating.

Installation and commissioning

NOSHOK series 621 and 622 transmitters are supplied with a 1/2 "NPT male conduit connection with either a 6 ft jacketed cable or 6 ft free leads. For transmitters supplied with a jacketed cable, a conduit seal is required. The free leaded version is factory sealed with epoxy and does not require a conduit seal when installed to NEC requirements.

Series 621 has threaded process connections and model 622 has G1/2B or G1B flush diaphragm connections. Refer to the catalog for complete specifications. Do not torque the process connector with a force greater than 37 foot pounds. Dust tight conduit seals must be used when installed in Class II and Class III installations.

For the 4 mA to 20 mA output version, install the power supply, transmitter and receiving instrument in a series circuit to form a 2 wire loop. The transmitter regulates the current in the loop.

The transmitter is classified for over-voltage category II and the pollution degree 1. For the voltage output version, the 3 wire system uses separate leads for the power supply and output signal. The 3rd lead is a common minus. Use a NEC Class 02 power supply, low voltage and low current maximum 100 VA even under fault conditions.

NOSHOK series 621 and 622 explosion-proof pressure transmitters require no maintenance. They are calibrated at the factory using pressure standards traceable to N.I.S.T. There are no user available adjustments.

**4 mA to 20 mA
2-wire**

WIRE	COLOR
+Supply	RED
+Output	BLACK

**Voltage Output
3-wire**

WIRE	COLOR
+Supply	RED
Common	BLACK
+Output	BROWN

HAZARDOUS (CLASSIFIED) LOCATION

CLASS I, DIVISION 1, GROUPS A, B, C
AND D
CLASS II, DIVISION 1, GROUPS E, F,
AND G
CLASS III

