




To install, remove the DIN 43650A plug and insert indicator on top of transducer and reinstall the plug. This indicator can be used with NOSHOK and some competitive transmitters with 2-wire 4 mA to 20 mA output, Hirschmann connector with the same pin configuration. (Pin 1 + supply, pin 2 + output)

To program, first remove the cover from the indicator housing and identify the buttons A, B, and C. These buttons are used to program the indicator to match the pressure range of the transmitter.

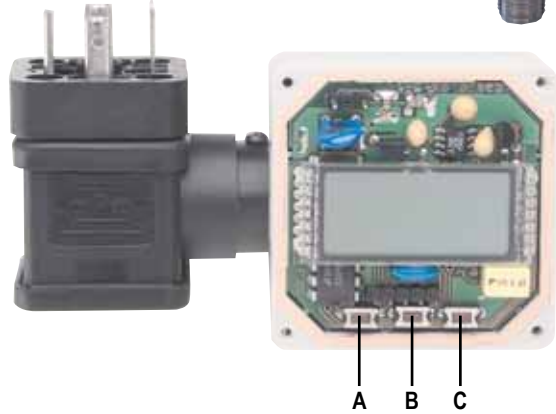

A → down  
 B → program steps  
 C → up

1. → **Set the decimal point**  
 1 X B: 

d	P		
---	---	--	--

  
 → C/A up or down
2. **Set the lower end of the range**  
 2 x B: 

A	n		4
---	---	--	---

  
 → C/A up or down
3. **Set the upper end of the range**  
 3 x B: 

A	n	2	0
---	---	---	---

  
 C/A up or down

4. **To enable error codes**  
 3 X B: 

L	1		
---	---	--	--

  
 1 x C: 

			1
--	--	--	---

 on  
 1 x A: 

			0
--	--	--	---

 off  
 → C/A up or down

Errors are shown as F1 for an underrange condition, and F2 for and overrange condition

5. **Set digital filtering range**  
 5 X B: 

F	I	L	T
---	---	---	---

  
 1 x C: 

			0
--	--	--	---

 0.2 seconds  
 2 x C: 

			1
--	--	--	---

 0.5 seconds  
 3 x C: 

			2
--	--	--	---

 1.0 seconds  
 → 4 x C: 

			3
--	--	--	---

 1.5 seconds  
 C/A up or down

6. **Return to measurement mode**  
 2 x A